

Keep these Instructions  
for future reference

Industries 1994 LTD  
PO Box 58652 Greenmount, Auckland  
[www.Warmington.co.nz](http://www.Warmington.co.nz)

Ensure That You Have The Correct And  
Current Installation Details For The Size  
Of The Warmington Fire That Is To Be  
Installed.

Due to continued product improvement, Warmington Ind LTD reserves the right to change product specifications without prior notification

## Flue Penetration Vented Through Chimney Chase


### NOTES

**EXTERNAL REQUIREMENTS**  
Refer to AS/NZS2918:2001: 4.9.1

Install flue system to AS/NZS2918:2001

When using a rubber or Butimen flashing (Butynol, Dektit) an additional flue pipe casing is required.

All external air vents & ceiling penetrations must be bird & rodent proofed with permanently fixed screens.

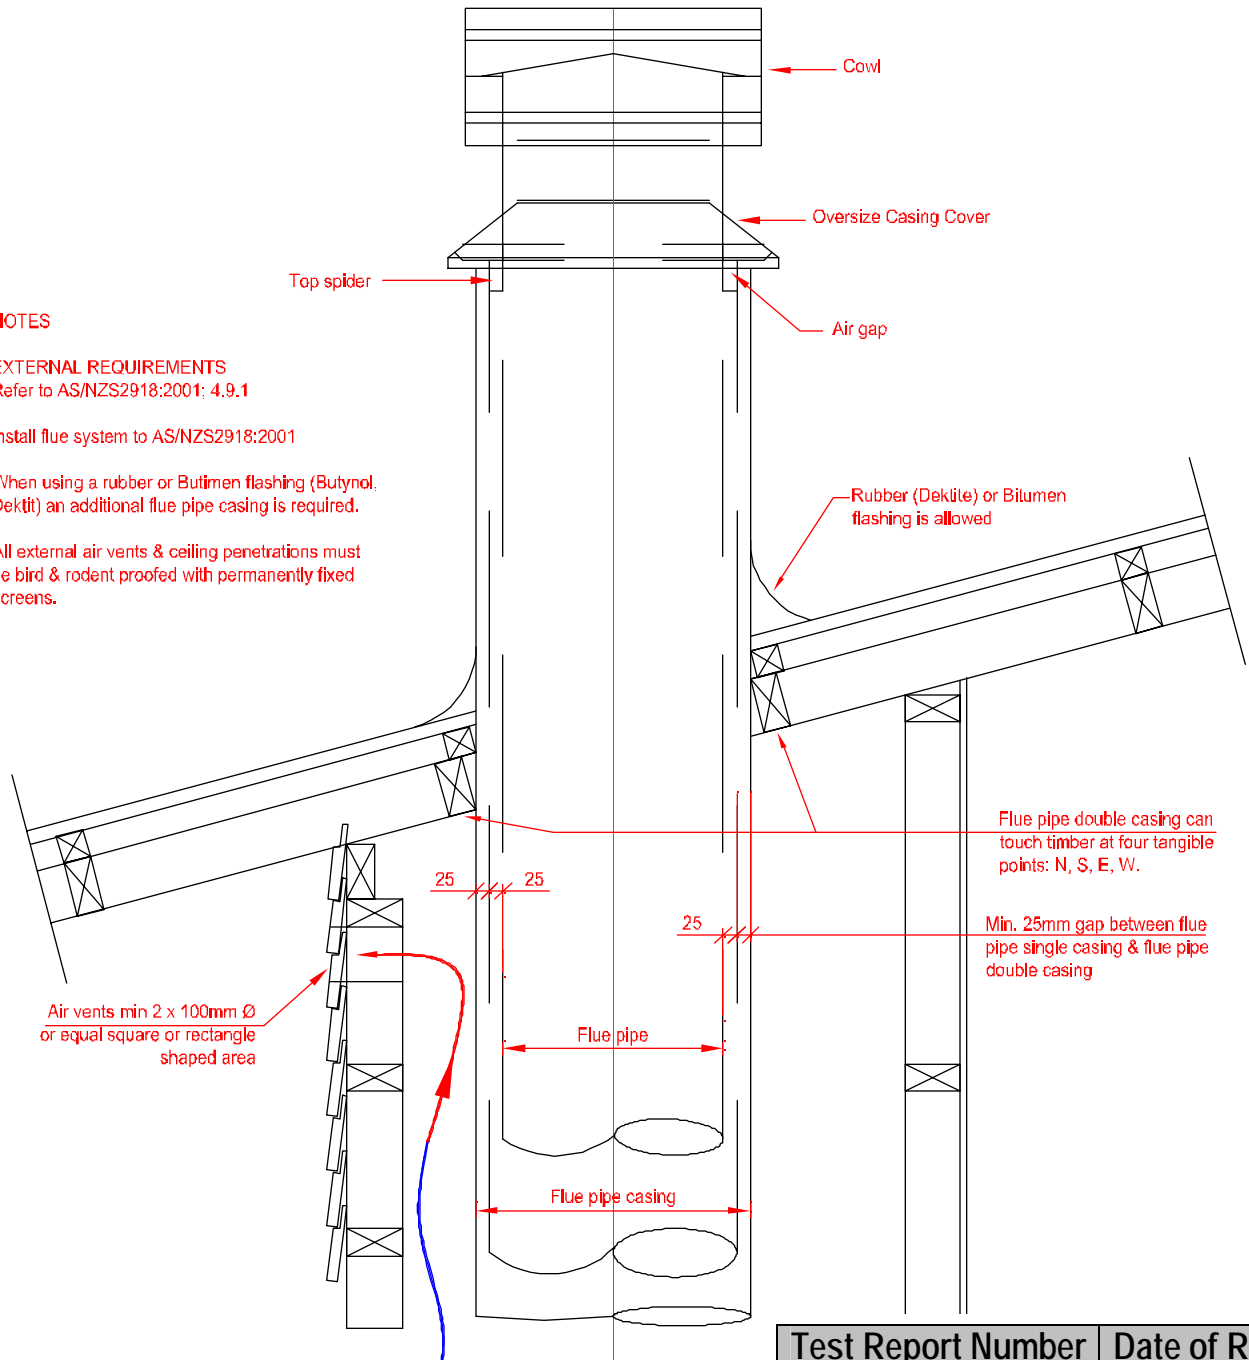

Test Report Number	Date of Report
04/1039	20 <sup>th</sup> July 2004
04/1040	20 <sup>th</sup> July 2004
04/1041	20 <sup>th</sup> July 2004